

Neao GMT Hardware Enterprise Co., Ltd.


TEST REPORT

REPORT NUMBER
200409021GZU-001

ISSUE DATE
2020/06/22

[REVISED DATE]
/

PAGES
5

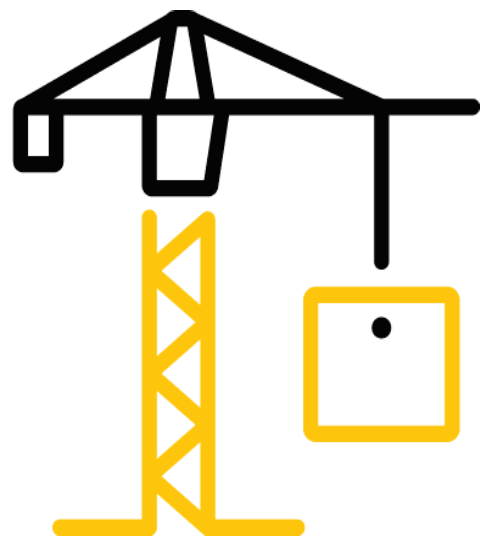

Test Report

Issue Date: 2020/06/22 Intertek Report No. 200409021GZU-001

Applicant: Neao GMT Hardware Enterprise Co., Ltd.

Applicant Address: 12F. No.107, Sec. 4, Zhongxiao E. Rd., Da'an Dist., Taipei City 10690, Taiwan

Attn: YEH JEN PING

SUBJECT: Performance testing
<<Floor Spring w/o Oil>>

Dear Sir,

This test report for represents the results of our evaluation of the above referenced product(s) to the requirements contained in the following standards:

TEST METHODS AND STANDARDS
Reference EN1154:1996/A1:2002/AC:2006 clause 5.2.2



SAMPLE ID	MODEL	SPECIFICATION
S200409021-001~002	NF-168	—

SAMPLE RECEIVED: 2020/04/07
TESTED FROM: 2020/04/22 TO 2020/06/16

Test lab address: Room 4103 & 4203, No. 63, Punan Road, Huangpu District, Guangzhou, China

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program. All the tests results give the statement of conformity refer to the decision rule of "Procedure 2 Accuracy Method" as stated in the IEC Guide 115:2007.

Test Report

Issue Date: 2020/06/22

Intertek Report No. 200409021GZU-001

Test Items, Method and Results:


No.	Test Item	Test Parameter	Test Result	Verdict
5.2.2	Durability	The door closer shall be able to close a test door conforming to 6.1.1 and 6.2 from an opening angle of 90°, for a minimum of 170 000 test cycles.	Door size: 900 x 2000 mm Door mass: 160 kg After 170, 000 cycles test function correctly.	Pass

Test Report

Issue Date: 2020/06/22

Intertek Report No. 200409021GZU-001

APPENDIX A: SAMPLE RECEIVED OR TEST PHOTO

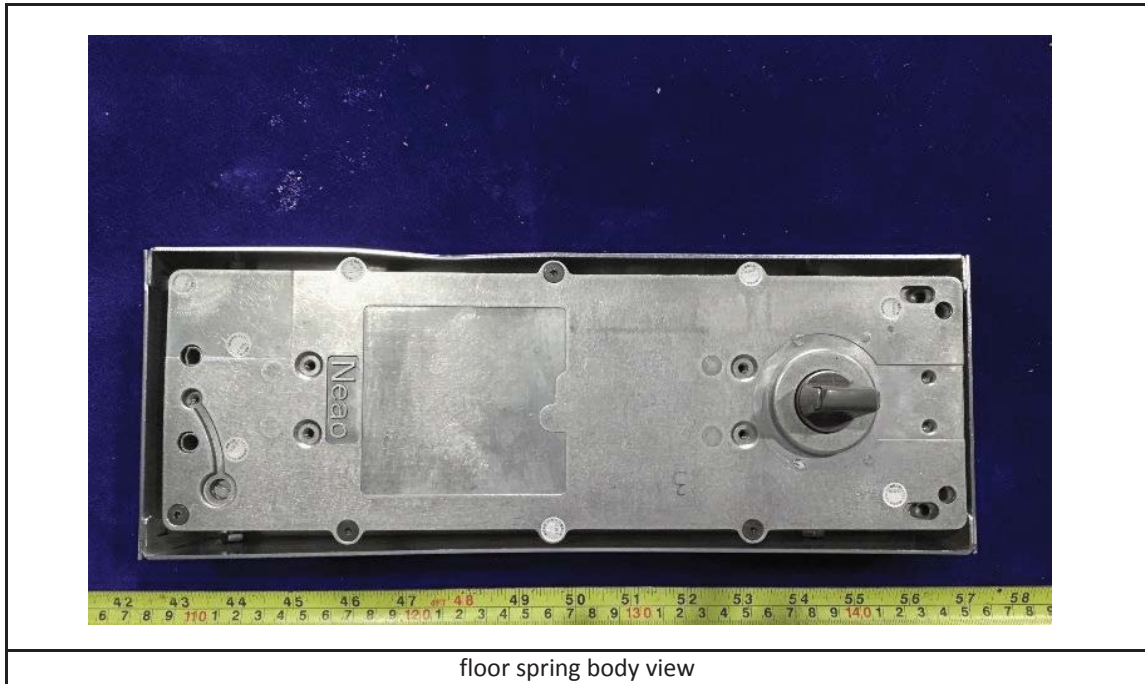

floor spring body view

Test Report

Issue Date: 2020/06/22

Intertek Report No. 200409021GZU-001

APPENDIX: SAMPLE RECEIVED PHOTO



NF-168

REPORT AUTHORIZED

When signed with physical or electronic signature, the contents of this report have been prepared and approved per Intertek's quality process in accordance with ISO 17025.

Approved by:

Prepared by:

Jordan Lin

Name: Jordan Lin
Title: Reviewer

Fingal Zhang

Name: Fingal Zhang
Title: Project Engineer

Revision:

Report No.	Date	Revision Reason	Revision Summary	Author	Reviewer
1	2020/6/22	/	First issue	Fingal Zhang	Jordan Lin

End of Test Report